

Air Handler Insulation Retainer Kit

Installation Instructions

For use with B3/PAH Series Air Handlers

Kit Part Numbers:

- A. Cabinet 904344
- B. Cabinet 904345
- C. Cabinet 904346

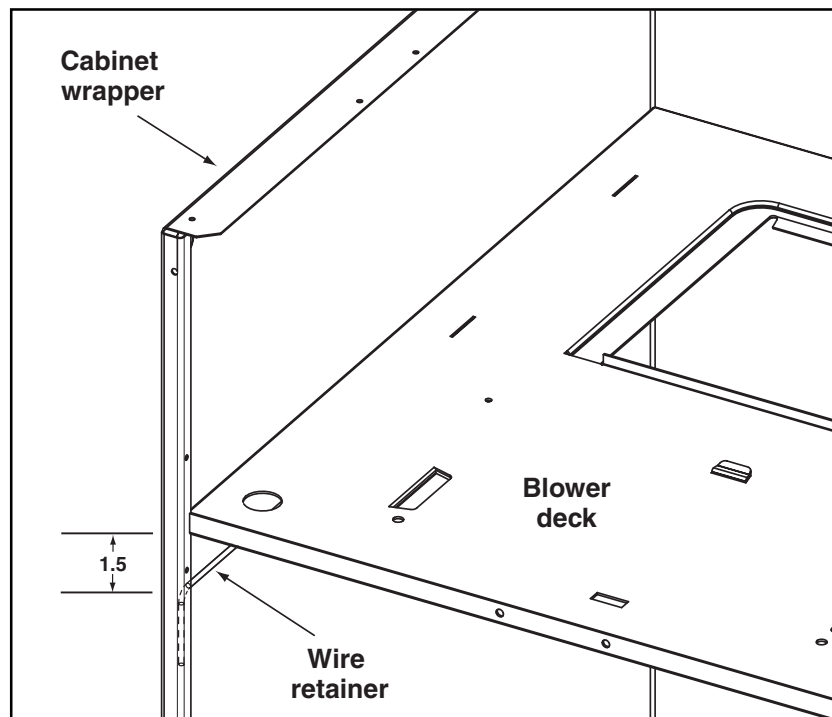


Figure 1. Insulation Retainer Location

INSTRUCTIONS

1. Remove blower door from air handler.
2. Insert wire retainer by manipulating around the blower assembly.
3. Locate the wire retainer in the back of the cabinet approximately 1.5 inches below the blower deck.
4. Push retainer towards back of unit and snap the short legs of the retainer behind the front cabinet flange. See figure 1.
5. Re-attach the blower door to the air handler.

